



Soap-dispenser automatic tap All-in-One, washbasin

mediclinics

EN

Mounted on the washbasin

Ref. DJ002AC/AB

Soap-dispenser tap

OVERVIEW

- Automatic gooseneck-style soap dispenser tap.
- Touch-free automatic operation helps optimize soap use with every hand wash.
- It can operate together with the M094AC/M094AB automatic hand dryer tap and/or the GA002AC/GA002AB automatic water tap, or independently.



DJ002AC

Chome-plated brass

Bright finish



DJ002AB


Brass

Black finish

TECHNICAL DATA

Voltage	220 – 240 V
Frequency	50/60 Hz
Life battery	60.000 cycles
Soap viscosity	100 – 3.500 cps
Soap dosage	0,5; 1,0; 1,5; 2,0 mL
Range detection	5 – 25 cm

DIMENSIONS

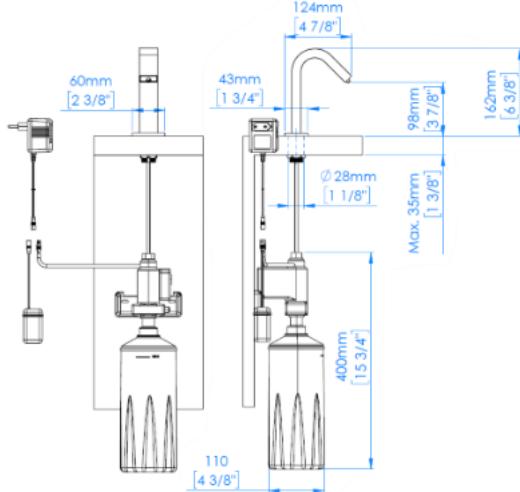

COMPONENTS AND MATERIALS

- Automatic soap dispenser tap with a sensor located above the soap outlet.
- Operates with a 220–240 V (AC) power adapter or with four 1.5 V AA batteries (DC). Adapter and battery holder included.
- The soap is stored in a 1.5 L plastic bottle and is dispensed through an anti-drip valve.
- The soap dose is adjustable.

PVD COATING AVAILABLE (consult us)



OPERATION

- Automatic operation using an infrared sensor with adjustable detection range.

Mediclinics S.A. reserves the right to make changes or modifications to the products and their specifications without prior notice.



www.mediclinics.com



REVISION: 12-25

Soap-dispenser automatic tap All-in-One, washbasin




≡ GUIDE SPECIFICATION

Single unit consisting of a soap dispenser tap for installation over the washbasin, made of brass with a bright chrome, black, or various PVD finishes. It features a sensor located beneath the soap outlet. It operates at a frequency of 50/60 Hz and a voltage of 220–240 V, or with 4x LR6 1.5 V batteries. The soap tank capacity is 1.50 L. Soap viscosity must range between 100–3,500 cps. The dispensed soap dose is adjustable to 0.5, 1.0, 1.5, or 2.0 mL. Motion detection distance is adjustable using a magnet between 5–25 cm.

☒ ASSEMBLY / RECOMMENDED INSTALLATION HEIGHTS

A washbasin that allows the installation of the All-in-One unit must be used, as shown in the following figure:

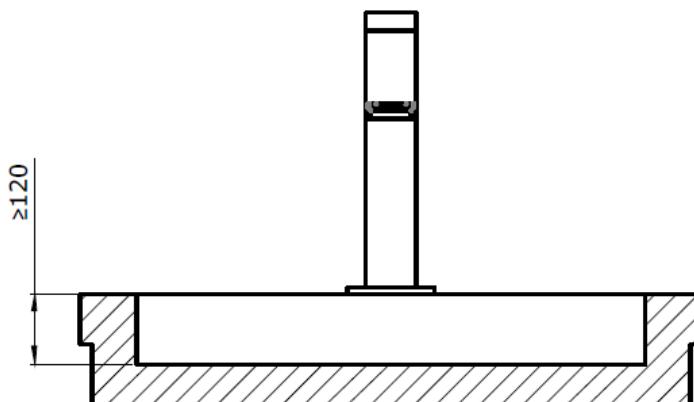

The washbasin must have a depth of at least 120 mm, with vertical walls and edges that are not excessively rounded in order to prevent splashing.

The tank must be positioned below the soap outlet.

⊗ CERTIFICATIONS



Mediclinics S.A. reserves the right to make changes or modifications to the products and their specifications without prior notice.



www.mediclinics.com



REVISION: 12-25